


MAXIMUM CAPACITY BOOTH PLAN

HALL A
427 10' x 10' EXHIBIT BOOTHS

HALL B
308 - 10' X 10' EXHIBIT BOOTHS
25 - 8' X 10' BOOTHS
(106 - 154 ARE 8' DEEP)

HALL C
264 - 10' X 10' BOOTHS
27 - 8' X 10' BOOTHS
19 - 9' X 10' BOOTHS

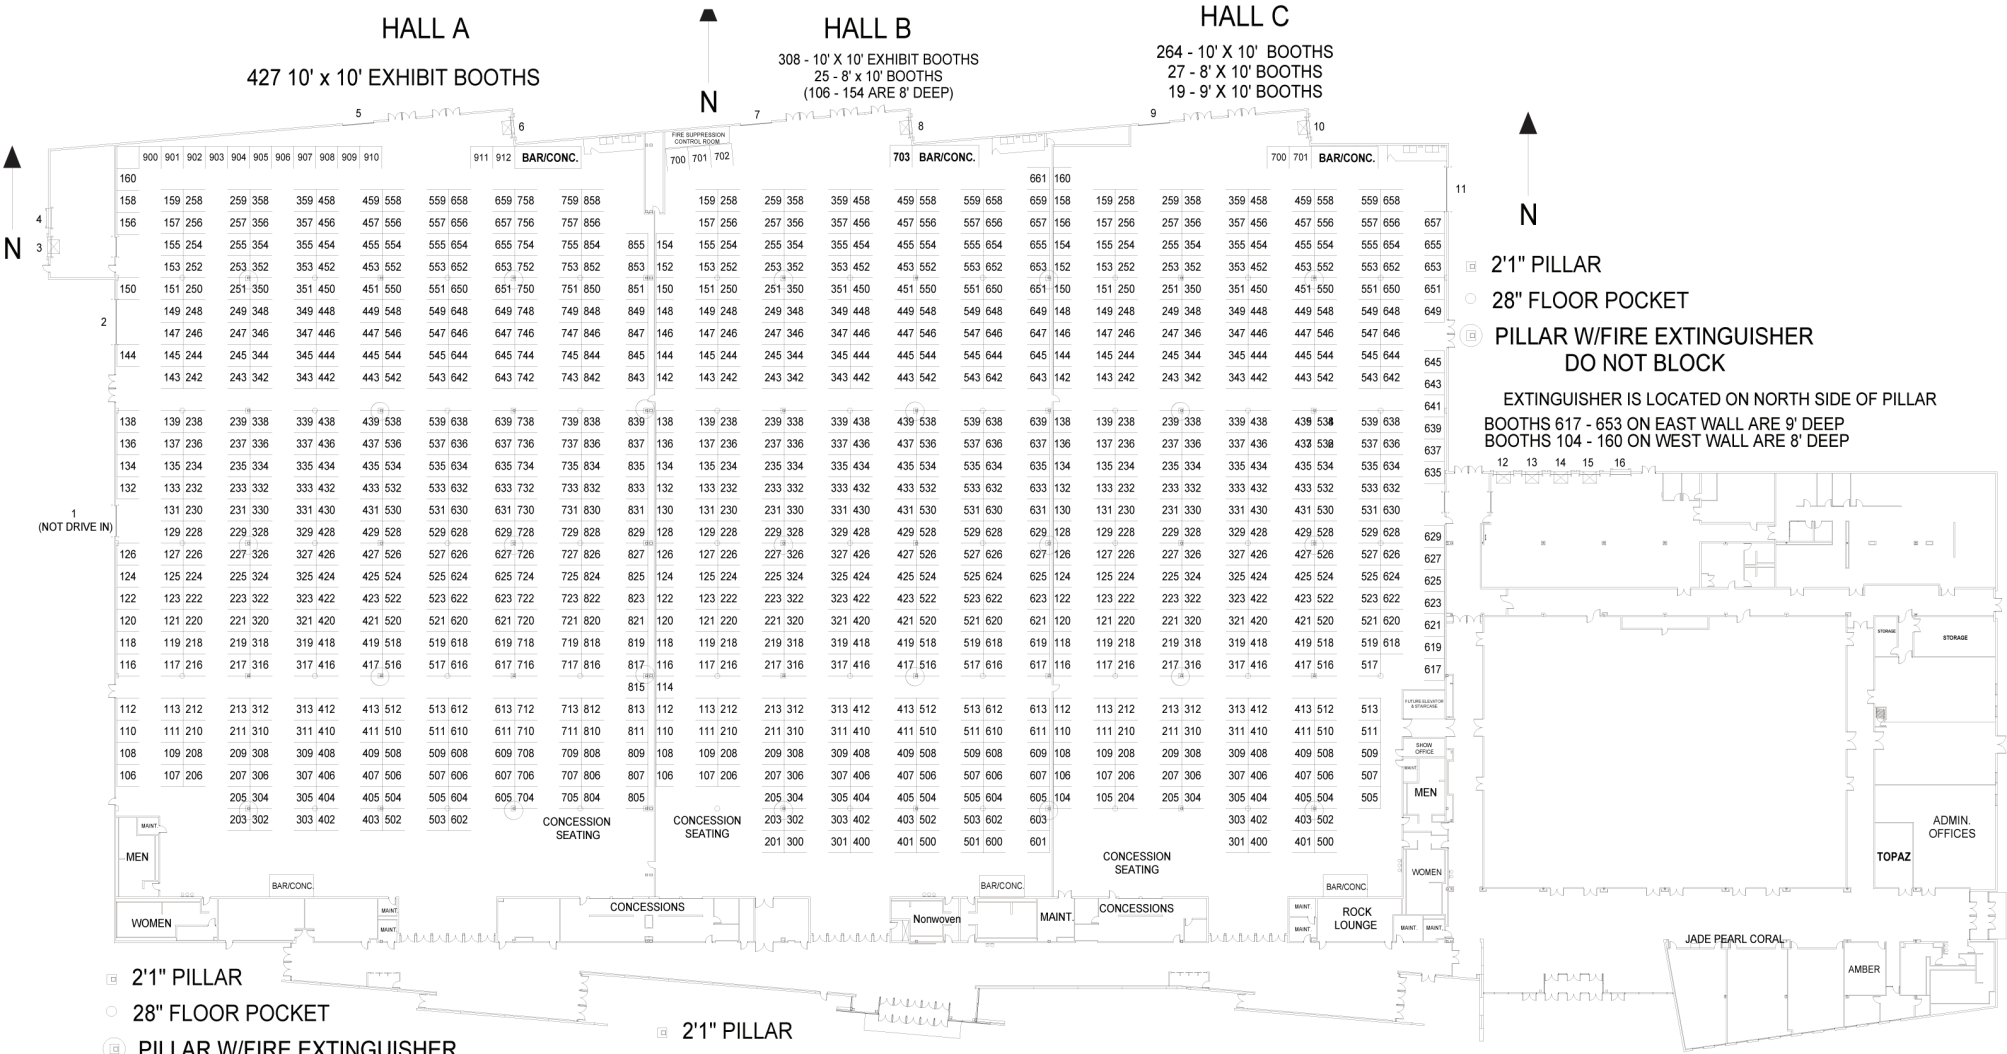

- ▣ 2'1" PILLAR
- 28" FLOOR POCKET
- ⊕ PILLAR W/FIRE EXTINGUISHER
DO NOT BLOCK

EXTINGUISHER IS LOCATED ON NORTH SIDE OF PILLAR
BOOTH 617 - 653 ON EAST WALL ARE 9' DEEP
BOOTH 104 - 160 ON WEST WALL ARE 8' DEEP

- ▣ 2'1" PILLAR
 - 28" FLOOR POCKET
 - ⊕ PILLAR W/FIRE EXTINGUISHER
DO NOT BLOCK
- EXTINGUISHER IS LOCATED ON NORTH SIDE OF PILLAR

- ▣ 2'1" PILLAR
 - 28" FLOOR POCKET
 - ⊕ PILLAR W/FIRE EXTINGUISHER
DO NOT BLOCK
- EXTINGUISHER IS LOCATED ON NORTH SIDE OF PILLAR

